


WATER REQUIREMENT

-AT FIELD ELEVATION
-WITHIN 100' OF FIELD
-DOWNSTREAM OF BACKFLOW IS 72 GPM @ 90 PSI

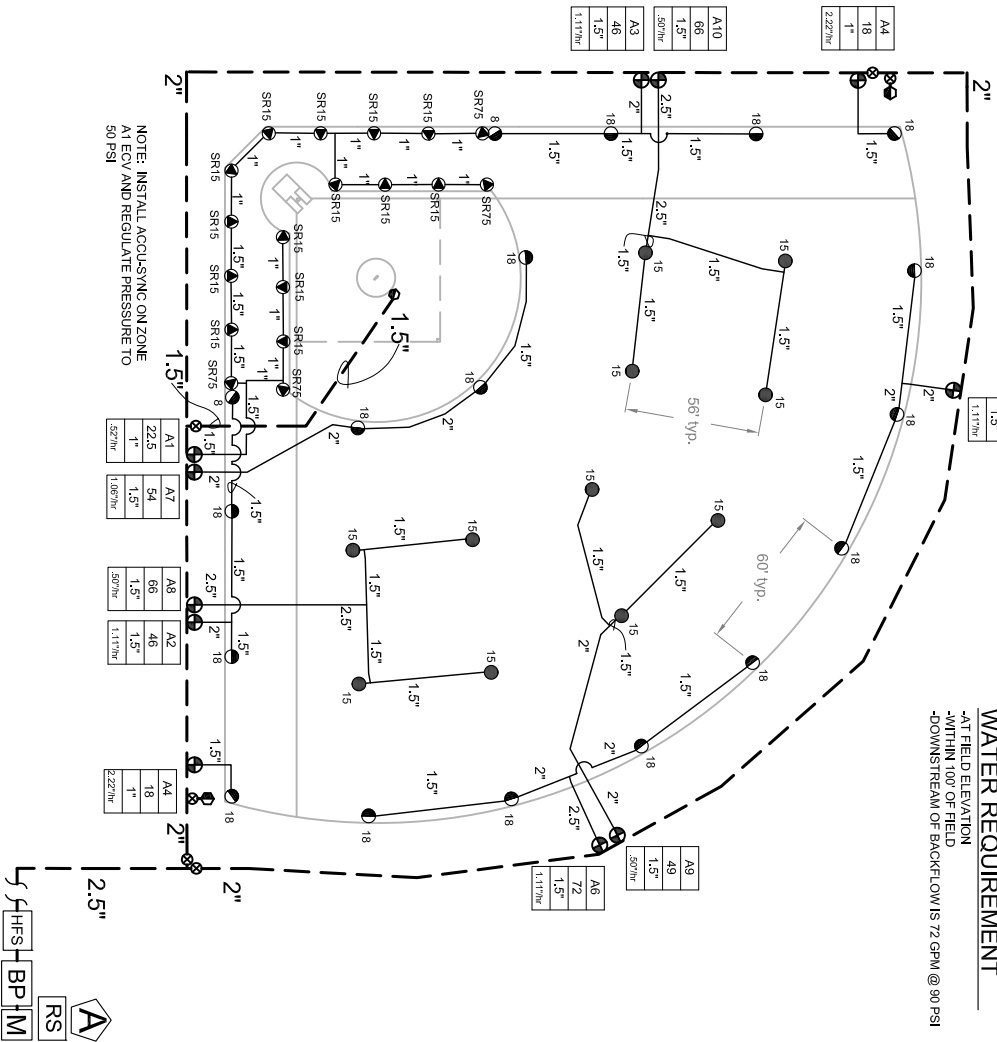

IRRIGATION LEGEND

PRODUCT DESCRIPTION

- HUNTER I-20-ADS-XXI-20-6P-ADS-XX NOZZLE AS SHOWN
- HUNTER I-25-04-SS-XXI-25-06-SS-XX NOZZLE AS SHOWN
- HUNTER I-25-04-SS-XXI-25-06-SS-XX NOZZLE AS SHOWN

NOZZLE PERFORMANCE:

- I-20: #SR1.5 @ 50 PSI - 1.5 GPM 25' RADIUS
- #SR.75 @ 50 PSI - 7.5 GPM 25' RADIUS
- I-25: #8 @ 70 PSI - 9.9 GPM 51' RADIUS
- #15 @ 80 PSI - 16.53 GPM 61' RADIUS
- #18 @ 80 PSI - 18.2 GPM 63' RADIUS

- ⊕ HUNTER ICV/IBV ELECTRIC CONTROL VALVE SIZE AS SHOWN
- ⊕ HUNTER HQ-44-XX-4AW QUICK COUPLER VALVE (OPTIONAL)
- ⊕ HUNTER ACC-1200 SOLID STATE METAL CABINET CONTROLLER
- ⊕ HUNTER SOLAR-SYNC-SEN ON SITE WEATHER SENSOR
- ⊕ WATER METER MINIMUM SIZE @ 72 GPM IS 2.0"
- ⊕ BACKFLOW PREVENTER SIZED TO SYSTEM GPM
- MAINLINE PIPE
- LATERAL PIPE
- SLEEVING
- ⊗ ISOLATION VALVE LINE SIZED
- ⊗ HUNTER FLOW SENSOR IN LINE SIZED FLOW CLIK TEE "FCT"

IRRIGATION NOTES

1. SPRINKLER LOCATIONS ARE TO SCALE
2. PIPE LOCATIONS ARE DIAGRAMMATIC
3. ALL SPRINKLERS TO BE INSTALLED ON 1" SCH 80 SWING JOINTS
4. ALL COMPONENTS TO BE INSTALLED AS PER MANUFACTURERS RECOMMENDATIONS
5. MAINLINE DEPTH TO BE NO LESS THAN 18"
6. LATERAL DEPTH TO BE NO LESS THAN 16"
7. ELECTRIC CONTROL VALVES TO BE COVERED WITH 12" VALVE BOX
8. LOCATE VALVES/COV'S OUT OF HIGH TRAFFIC AREAS
9. WIRE SPLICE CONNECTIONS TO BE WATERPROOF
10. COV TO BE LOCATED IN 10" VALVE BOX
11. ALL SLEEVES TO BE 2X PIPE RUN THROUGH THEM
12. INSTALL ALL COMPONENTS AS PER LOCAL, STATE, FEDERAL CODES
13. REFER TO HUNTER INSTALLATION DETAILS
14. REFER TO HUNTER CATALOG FOR PERFORMANCE SPECIFICATIONS
15. ADD HUNTER "FS" FOR DIRTY WATER VALVE
16. ADD HUNTER "AS" FOR PRESSURE REGULATED VALVE

VALVE ID GUIDE

A1	STATION NUMBER	SIZE	FLOW	PR	DU	SC
55	A1	1.5"	22.5	.53"	.86	1.2
1.5"	A2	1.5"	46	1.11"	.80	1.3
50"/hr	A3	1.5"	16	2.27"	.80	1.3
	A4	1.5"	54	1.11"	.80	1.3
	A5	1.5"	72	1.11"	.80	1.3
	A6	1.5"	54	1.06"	.80	1.3
	A7	1.5"	66	.50"	.86	1.2
	A8	1.5"	49	.50"	.86	1.2
	A9	1.5"	66	.50"	.86	1.2
	A10	1.5"	66	.50"	.86	1.2

SYSTEM PERFORMANCE DATA

A1	STATION NUMBER	ZONE	SIZE	FLOW	PR	DU	SC
55	A1	1.5"	22.5	.53"	.86	1.2	
1.5"	A2	1.5"	46	1.11"	.80	1.3	
50"/hr	A3	1.5"	16	2.27"	.80	1.3	
	A4	1.5"	54	1.11"	.80	1.3	
	A5	1.5"	72	1.11"	.80	1.3	
	A6	1.5"	54	1.06"	.80	1.3	
	A7	1.5"	66	.50"	.86	1.2	
	A8	1.5"	49	.50"	.86	1.2	
	A9	1.5"	66	.50"	.86	1.2	
	A10	1.5"	66	.50"	.86	1.2	

Hunter Industries offers this plan as a general guide for estimating purposes and offers no warranty, express or implied, for the accuracy of the information contained herein. The user of this system and of every site we recommend that a qualified irrigation designer be consulted.



OFFICIAL SOFTBALL FIELD

I-25 DESIGN
LOOPED MAINLINE

Hunter Industries
1940 Diamond Street
San Marcos, California 92078
SpecPro Technical Assistance
1-800-319-4796
www.HunterIndustries.com

SHEET

1 OF 1