

GENERAL IRRIGATION NOTES




- EQUIPMENT LOCATIONS ARE DIAGRAMMATIC AND ARE SHOWN ON PLAN FOR GRAPHIC CLARITY.
- ALL IRRIGATION EQUIPMENT SHALL BE INSTALLED AS PER MANUFACTURER'S RECOMMENDATIONS AND SPECIFICATIONS.
- ALL SPRINKLER HEADS SHALL BE SET PERPENDICULAR TO FINISH GRADE UNLESS OTHERWISE SPECIFIED. INSTALL ALL HEADS WITH DOUBLE SWING JOINTS.
- IRRIGATION EQUIPMENT AND INSTALLATION METHODS SHALL ADHERE TO LOCAL, STATE, AND FEDERAL CODES.
- ALL REMOTE CONTROL VALVES, BALL VALVES, QUICK COUPLERS, ETC. SHALL BE INSTALLED IN SUBGRADE VALVE BOXES. VALVE BOXES SHALL BE LOCATED OUT OF PLAY AND HIGH TRAFFIC AREAS. VALVE BOXES SHALL BE HEAT BRANDED IN 2" LETTERING IDENTIFYING THE IRRIGATION COMPONENT FOUND INSIDE THE BOX AND CONTROLLER AND STATION NUMBER WHEN APPLICABLE.
- ALL VALVES ARE TO BE FASTENED WITH VALVE IDENTIFICATION TAGS IDENTIFYING STATION # AND APPROPRIATE CONTROLLER IDENTIFICATION INFORMATION.
- SLEEVES SHALL BE PLACED UNDER ALL DRIVEWAYS AND WALKS WHERE IRRIGATION LATERAL, MAINLINE, AND WIRE WILL CROSS. SLEEVES SHALL BE MINIMUM BURY 24" DEEP. MINIMUM DISTANCE PAST EDGE OF DRIVEWAY OR CONCRETE WALK SHALL BE 24". WATER AND WIRE SHALL NOT BE PLACED IN THE SAME SLEEVE. SLEEVES TO BE TWICE THE DIAMETER OF THE PIPE BEING SLEEVED. WIRE SLEEVES TO BE 2" DIAMETER MINIMUM.
- UNDERGROUND MARKING TAPE SHALL BE RUN WITH ALL MAINLINES AND MUST BE INSTALLED AT LEAST 6" ABOVE TOP OF PIPE.
- INSTALLER SHALL USE WATERPROOF CONNECTORS FOR ALL WIRE SPICE CONNECTIONS.
- THE INSTALLER SHALL FLUSH AND ADJUST ALL SPRINKLER HEADS AND VALVES (BOTH EXISTING AND NEW) FOR OPTIMUM COVERAGE WITH MINIMAL MISTING AND/OR OVER SPRAY ONTO WALKS, STREETS, WALLS, ETC.

SYSTEM PERFORMANCE DATA

ZONE	SIZE	FLOW	PRECIPITATION RATE ¹ / _{hr}	DISTRIBUTION UNIFORMITY _{LQ}	SCHEDULING COEFFICIENT
A1	2.0"	55.40 GPM	1.43	0.86	1.2
A2	2.0"	83.10 GPM	1.48	0.84	1.2
A3	2.0"	83.10 GPM	1.90	0.84	1.2
A4	2.0"	61.80 GPM	0.73	0.90	1.1
A5	2.0"	92.70 GPM	0.69	0.80	1.3
A6	2.0"	46.40 GPM	0.77	0.93	1.1
A7	2.0"	55.40 GPM	5.49	0.84	1.2
A8	2.0"	55.40 GPM	1.28	0.80	1.3
A9	1.0"	18.00 GPM	0.59	0.93	1.1
A10	2.0"	52.00 GPM	1.16	0.86	1.2
A11	1.0"	7.40 GPM	0.91	0.80	1.3
A12	1.0"	12.20 GPM	1.04	0.93	1.1
A13	1.0"	18.00 GPM	0.64	0.90	1.1
A14	2.0"	55.40 GPM	1.23	0.83	1.3
A15	2.0"	55.40 GPM	5.34	0.89	1.1
A16	2.0"	92.70 GPM	0.69	0.81	1.3
A17	2.0"	83.10 GPM	1.87	0.84	1.2
A18	2.0"	77.30 GPM	0.77	0.85	1.2
A19	2.0"	83.10 GPM	1.59	0.85	1.2

VALVE IDENTIFICATION GUIDE

SYMBOL	MANUFACTURER/MODEL/DESCRIPTION
	Hunter ICV-G 1" 1", 1-1/2", 2", and 3" Plastic Electric Remote Control Valves, Globe Configuration, with NPT Threaded Inlet/Outlet, for Commercial/Municipal Use.
	Hunter ICV-G 1-1/2" 1", 1-1/2", 2", and 3" Plastic Electric Remote Control Valves, Globe Configuration, with NPT Threaded Inlet/Outlet, for Commercial/Municipal Use.
	Hunter ICV-G 2" 1", 1-1/2", 2", and 3" Plastic Electric Remote Control Valves, Globe Configuration, with NPT Threaded Inlet/Outlet, for Commercial/Municipal Use.
	Hunter A2C-75D-SS 75-Station Decoder controller in a stainless steel wall mount enclosure.
	Water Meter 2"
	Irrigation Lateral Line: PVC Class 200 SDR 21 1"
	Irrigation Lateral Line: PVC Class 200 SDR 21 1 1/4"
	Irrigation Lateral Line: PVC Class 200 SDR 21 1 1/2"
	Irrigation Lateral Line: PVC Class 200 SDR 21 2"
	Irrigation Lateral Line: PVC Class 200 SDR 21 2 1/2"
	Irrigation Lateral Line: PVC Class 200 SDR 21 3"
	Irrigation Mainline: PVC Class 315 SDR 13.5 3"
	Irrigation Mainline: PVC Class 315 SDR 13.5 4"

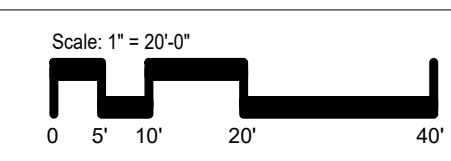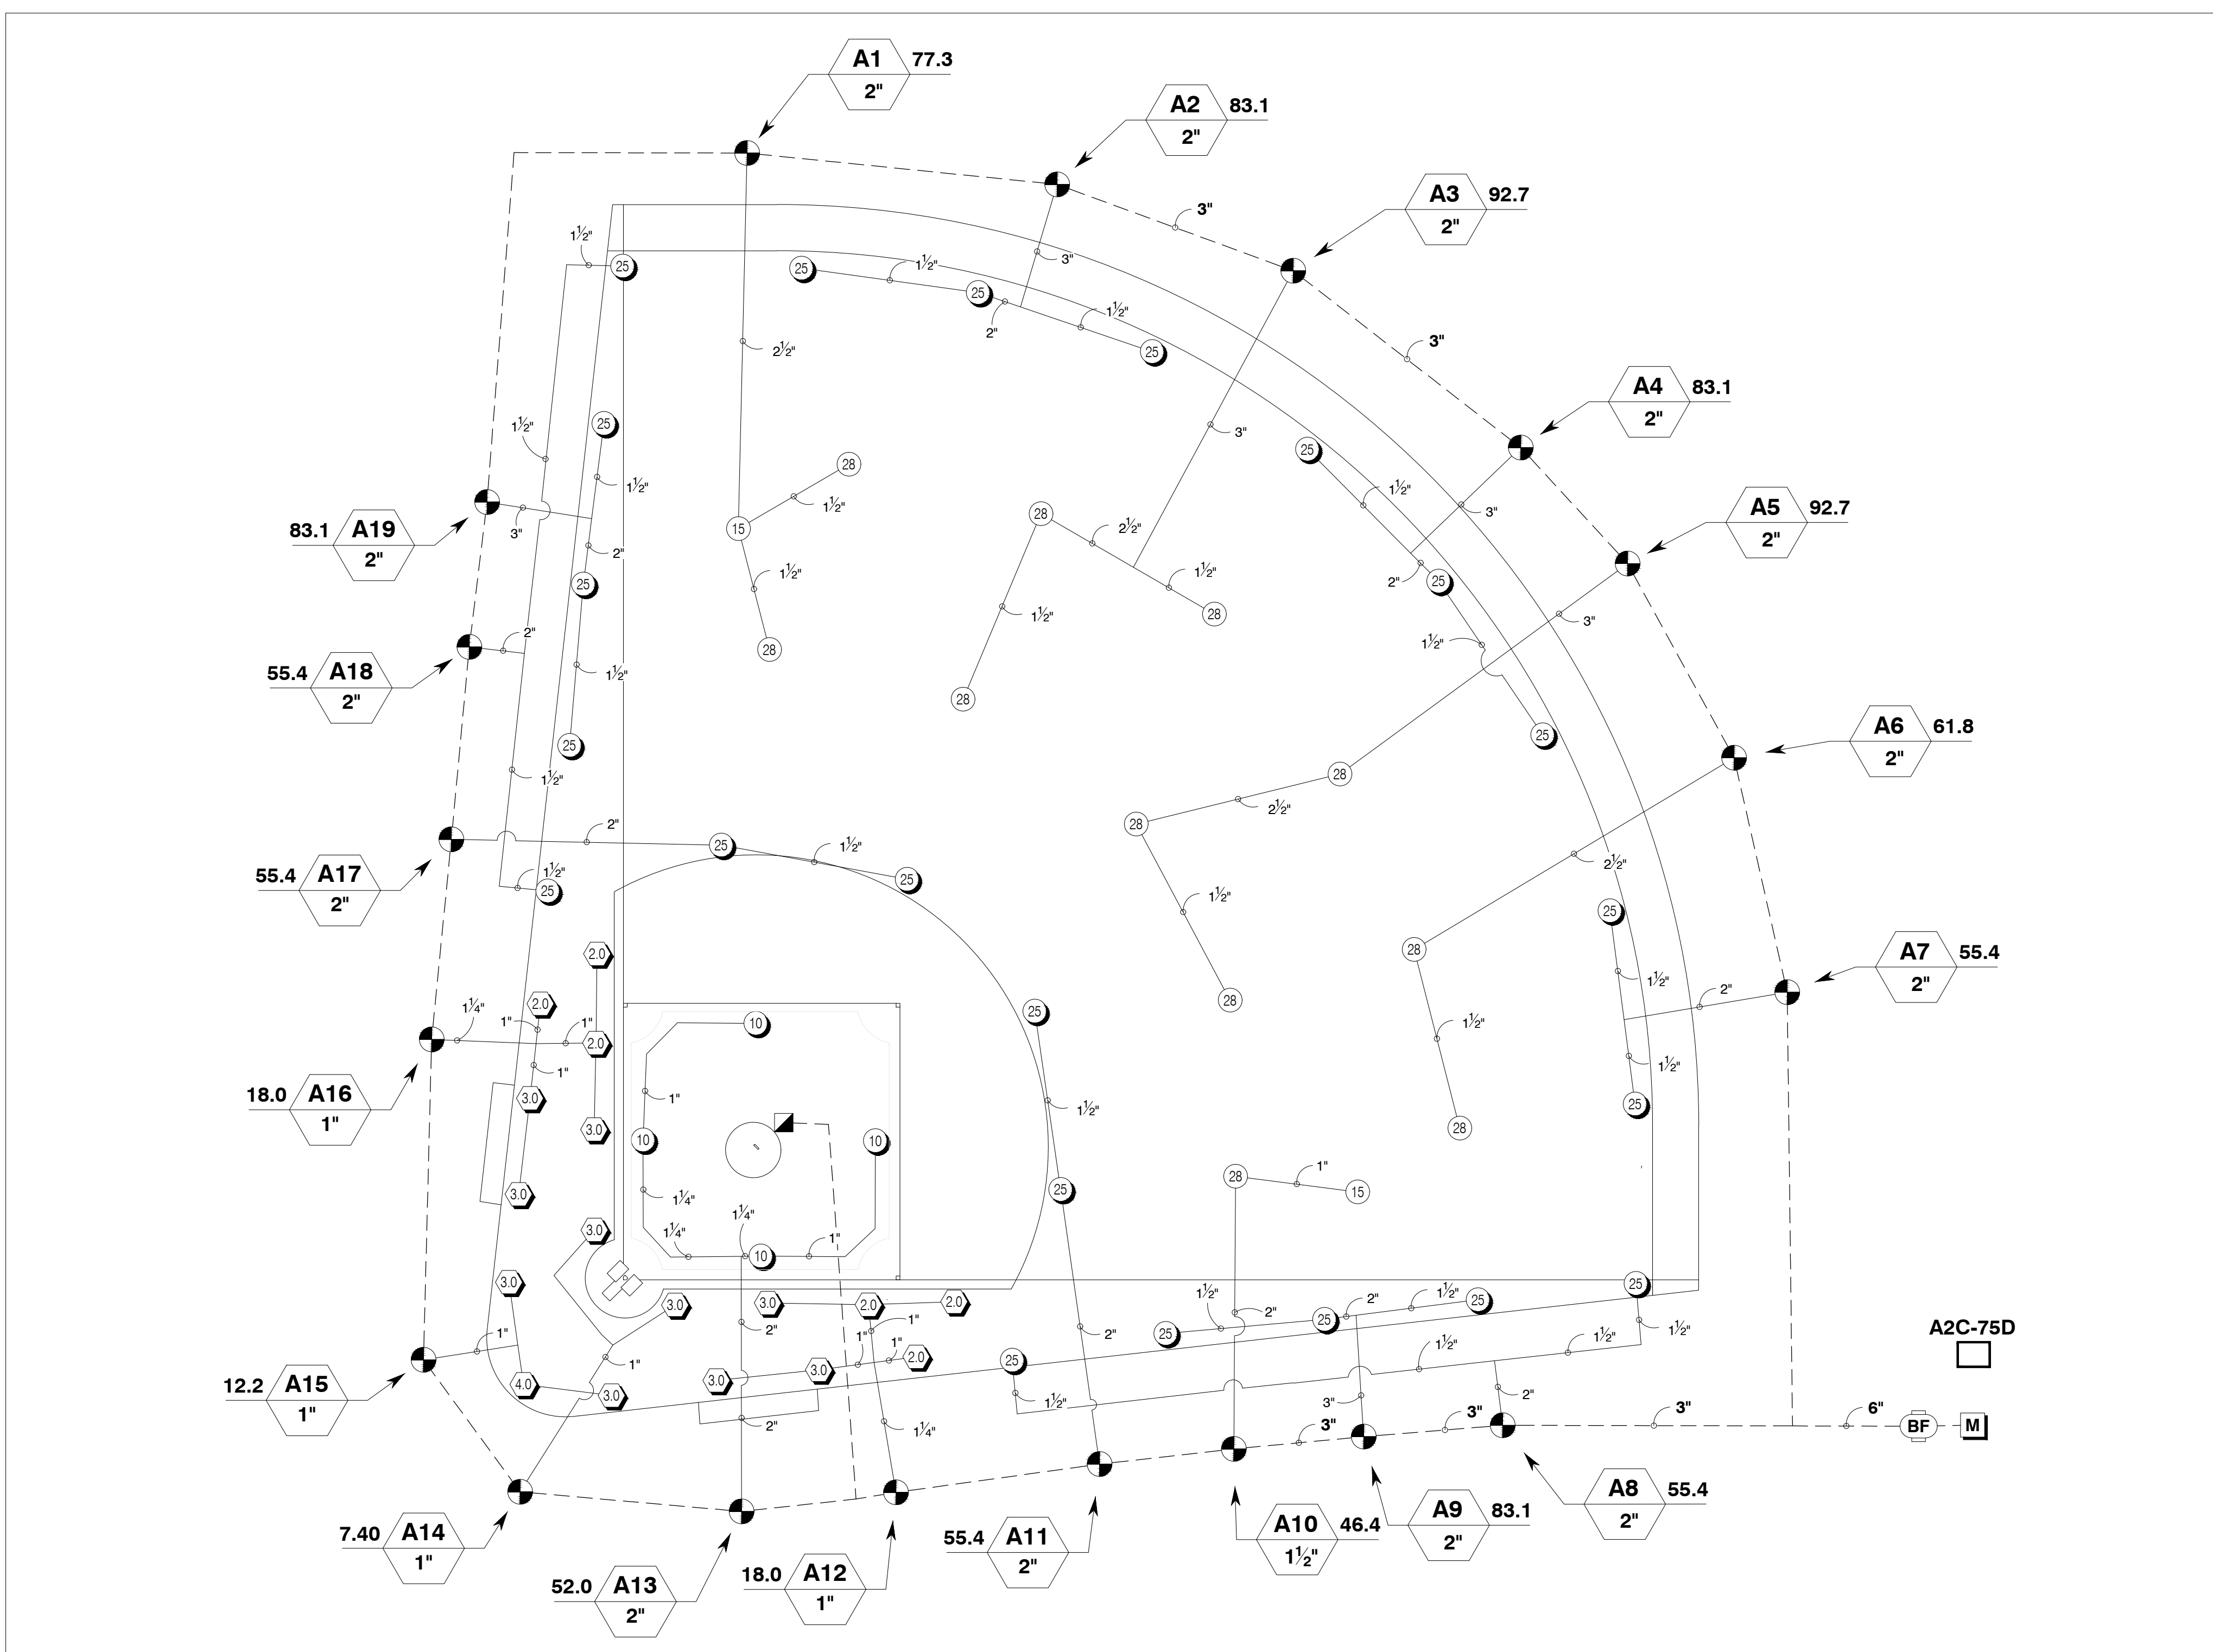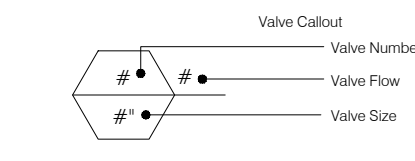

IRRIGATION LEGEND

SYMBOL	MANUFACTURER/MODEL/DESCRIPTION	QTY	PSI	GPM	RADIUS
	Hunter I-20-06-SS Turf Rotor, 6.0" Pop-Up, Adjustable and Full Circle. Stainless Steel Riser, Drain Check Valve, Standard Nozzle.	6	65	2.30	28'
	Hunter I-20-06-SS Turf Rotor, 6.0" Pop-Up, Adjustable and Full Circle. Stainless Steel Riser, Drain Check Valve, Standard Nozzle.	10	65	3.70	35'
	Hunter I-20-06-SS Turf Rotor, 6.0" Pop-Up, Adjustable and Full Circle. Stainless Steel Riser, Drain Check Valve, Standard Nozzle.	1	65	4.80	36'
	Hunter I-50-06-SS Turf Rotor, 6.0" Pop-Up, Adjustable to Full Circle, Drain Check Valve, Stainless Steel Riser, 1" Female NPT Inlet Threads, Standard Nozzle.	4	80	13.0	45'
	Hunter I-50-06-SS Turf Rotor, 6.0" Pop-Up, Adjustable to Full Circle, Drain Check Valve, Stainless Steel Riser, 1" Female NPT Inlet Threads, Standard Nozzle.	22	80	27.7	61'
	Hunter I-50-06-SS-ON Turf Rotor, 6.0" Pop-Up, Adjustable to Full Circle, Drain Check Valve, Stainless Steel Riser, 1" Female NPT Inlet Threads, Dual Opposing Nozzle.	2	80	15.5	51'
	Hunter I-50-06-SS-ON Turf Rotor, 6.0" Pop-Up, Adjustable to Full Circle, Drain Check Valve, Stainless Steel Riser, 1" Female NPT Inlet Threads, Dual Opposing Nozzle.	11	80	30.9	64'

WATER REQUIREMENT

REQUIRED FLOW: 120 GPM
REQUIRED PRESSURE: 117 PSI

Hunter Industries offers this plan as a general guide for estimating purposes and offers no indemnity, expressed or implied, for projects installed from this plan. Consult a qualified irrigation designer to account for system and site variables.